

15 Amp Circuit Required




ADDITIONAL CONNECTIONS
FREEZER OPTIONAL

NOTE: If Auxiliary Lights are not powered from the Door Circuit, the Red Aux Wire from the Door Circuit must be capped off or removed by Qualified Electrician

Update:11/16/22

Field Connection
120V / 60V / 1PH
15 Amp Circuit Required

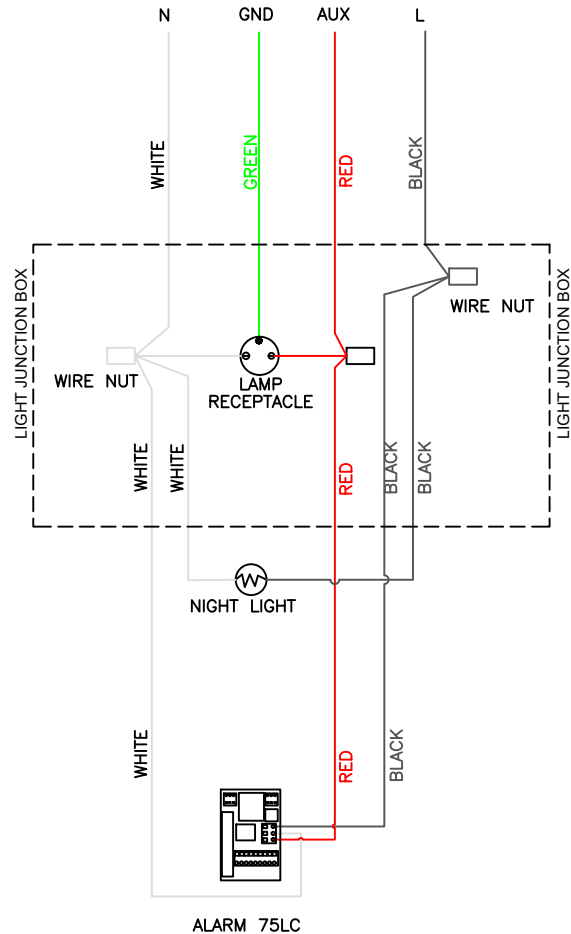

Arctic®
WALK-IN COOLERS AND FREEZERS
Engineering Reimagined®

FLORIDA, USA (305) 883-5581
CALIFORNIA, USA (626) 508-0920




ELECTRICIAN MUST PROVIDE
SEAL-OFFS ON THE WARM SIDE
OF ALL INCOMING CONDUIT
LINES TO PREVENT
CONDENSATION FROM FORMING
INSIDE THE CONDUIT.
(SEE DETAILS PAGE)




This is a 120VAC, 15 amp circuit auxiliary lights max combined draw 10 amps	
Manufacturer	Model
Keil (Component Hardware)	LED48X754
Kason	1802, 1802NL, 1803, 1804, 1806, 1807, 1808, 1808NM, 1808FM, 1809, 1810EZ Series, 1810LX, 1810LC, 1820
MaxLite	LSV Series, JJ Series
Osram Sylvania	30099 Series
Various	UL Listed 120VAC, no greater than 60 watts

ADDITIONAL CONNECTIONS

FREEZER



OPTIONAL



NOTE: Door Heater, Thermal Switch and Heated Relief Port included on Freezers only.
Door Heater and Thermal Switch optional on Coolers


NOTE: If Auxiliary Lights are not powered from the Door Circuit, the Red Aux Wire from the Door Circuit must be capped off or removed by Qualified Electrician

SINGLE POLE WIRING DIAGRAM FOR A/V ALARM 75LC

NOTE: DOOR MUST BE DISCONNECTED FROM ELECTRICAL SUPPLY FOR INSTALLATION AND ADJUSTMENTS.
NOTE: CONDUIT PENETRATIONS MUST BE SEALED INTERNALLY AND EXTERNALLY WHERE THEY ENTER THE WALK-IN BOX.

Update: 11/16/22


Field Connection
120V / 60V / 1PH
15 Amp Circuit Required

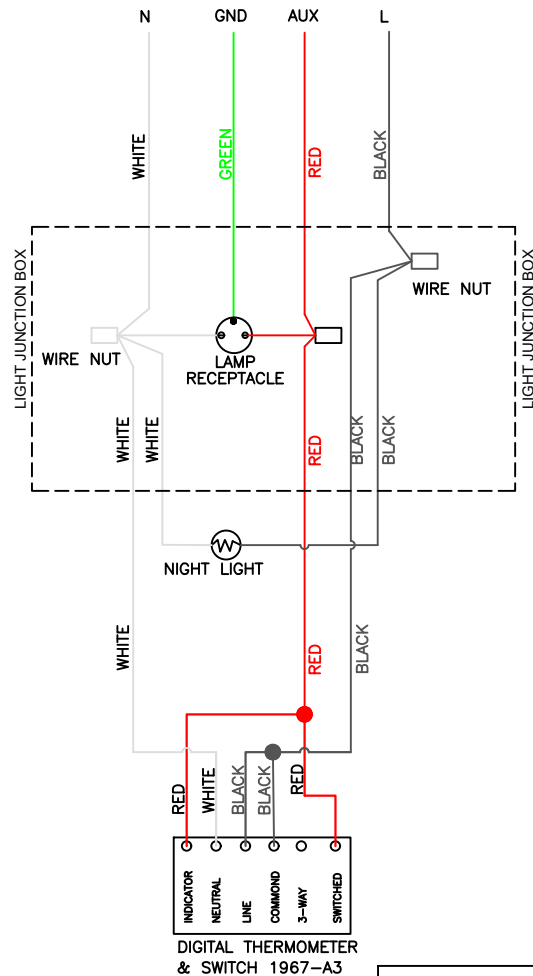




This is a 120VAC, 15 amp circuit auxiliary lights max combined draw 10 amps	
Manufacturer	Model
Keil (Component Hardware)	LED48X754
Kason	1802, 1802NL, 1803, 1804, 1806, 1807, 1808,
	1808NM, 1808FM, 1809, 1810EZ Series, 1810LX, 1810LC, 1820
MaxLite	LSV Series, JJ Series
Osram Sylvania	30099 Series
Various	UL Listed 120VAC, no greater than 60 watts

ADDITIONAL CONNECTIONS

FREEZER



OPTIONAL



NOTE: Door Heater, Thermal Switch and Heated Relief Port included on Freezers only.
Door Heater and Thermal Switch optional on Coolers

NOTE: If Auxiliary Lights are not powered from the Door Circuit, the Red Aux Wire from the Door Circuit must be capped off or removed by Qualified Electrician

ELECTRICIAN MUST PROVIDE SEAL-OFFS ON THE WARM SIDE OF ALL INCOMING CONDUIT LINES TO PREVENT CONDENSATION FROM FORMING INSIDE THE CONDUIT. (SEE DETAILS PAGE)



WALK-IN COOLERS AND FREEZERS

Engineering Reimagined®

FLORIDA, USA (305) 883-5581
CALIFORNIA, USA (626) 508-0920

SINGLE POLE WIRING DIAGRAM FOR LIGHT SWITCH/THERM 1967-A3


NOTE: DOOR MUST BE DISCONNECTED FROM ELECTRICAL SUPPLY FOR INSTALLATION AND ADJUSTMENTS.
NOTE: CONDUIT PENETRATIONS MUST BE SEALED INTERNALLY AND EXTERNALLY WHERE THEY ENTER THE WALK-IN BOX.

Update: 11/16/22

Field Connection

120V / 60V / 1PH

15 Amp Circuit Required

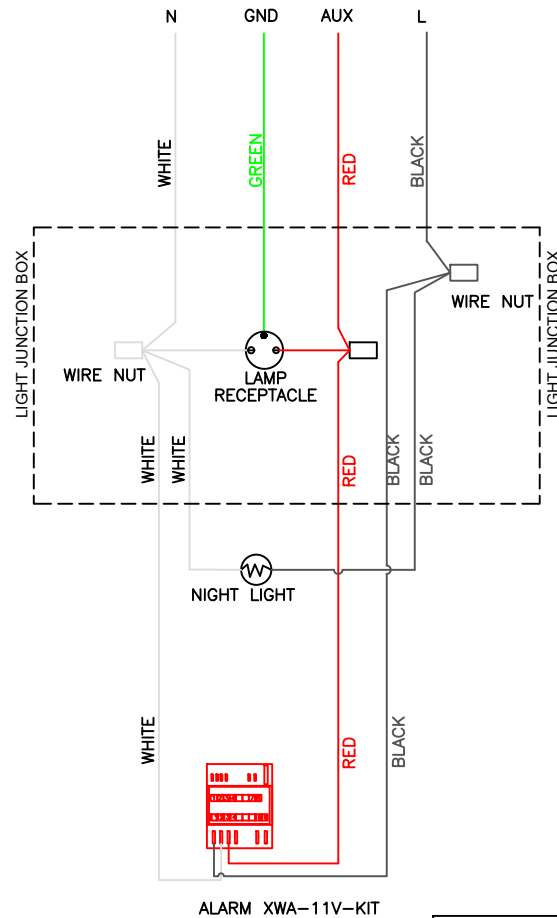

Arctic
WALK-IN COOLERS AND FREEZERS
Engineering Reimagined®

FLORIDA, USA (305) 883-5581
CALIFORNIA, USA (626) 508-0920







ELECTRICIAN MUST PROVIDE
SEAL-OFFS ON THE WARM SIDE
OF ALL INCOMING CONDUIT
LINES TO PREVENT
CONDENSATION FROM FORMING
INSIDE THE CONDUIT.
(SEE DETAILS PAGE)

This is a 120VAC, 15 amp circuit auxiliary lights max combined draw 10 amps	
Manufacturer	Model
Keil (Component Hardware)	LED48X754
Kason	1802, 1802NL, 1803, 1804, 1806, 1807, 1808, 1808NM, 1808FM, 1809, 1810EZ Series, 1810LX, 1810LC, 1820
MaxLite	LSV Series, JJ Series
Osram Sylvania	30099 Series
Various	UL Listed 120VAC, no greater than 60 watts

ADDITIONAL CONNECTIONS

FREEZER

OPTIONAL




NOTE: Door Heater, Thermal Switch and Heated Relief Port included on Freezers only.
Door Heater and Thermal Switch optional on Coolers

NOTE: If Auxiliary Lights are not powered from the Door Circuit, the Red Aux Wire from the Door Circuit must be capped off or removed by Qualified Electrician

SINGLE POLE WIRING DIAGRAM FOR ALARM XWA-11V-KIT

NOTE: DOOR MUST BE DISCONNECTED FROM ELECTRICAL SUPPLY FOR INSTALLATION AND ADJUSTMENTS.
NOTE: CONDUIT PENETRATIONS MUST BE SEALED INTERNALLY AND EXTERNALLY WHERE THEY ENTER THE WALK-IN BOX.


Update:11/16/22

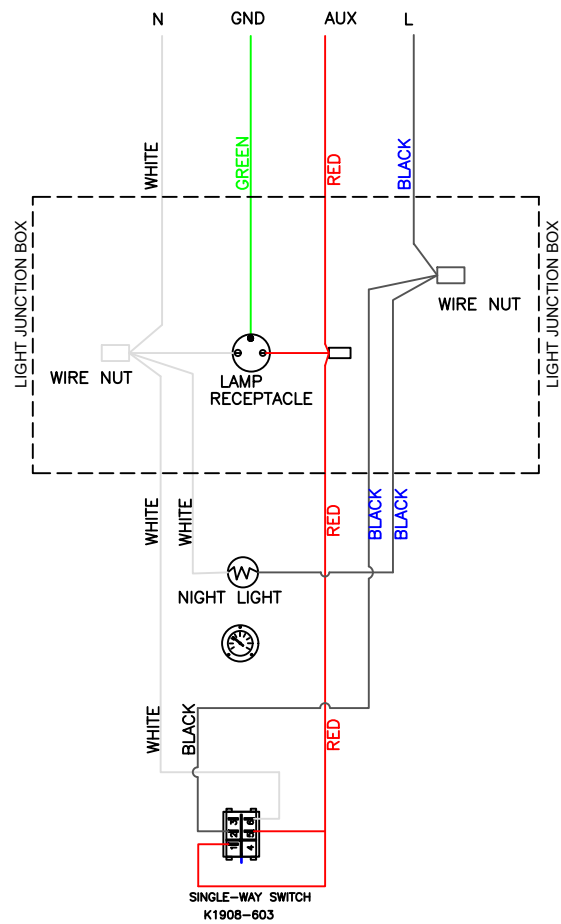




This is a 120VAC, 15 amp circuit auxiliary lights max combined draw 10 amps	
Manufacturer	Model
Keil (Component Hardware)	LED48X754
Kason	1802, 1802NL, 1803, 1804, 1806, 1807, 1808, 1808NM, 1808FM, 1809, 1810EZ Series, 1810LX, 1810LC, 1820
MaxLite	LSV Series, JJ Series
Osram Sylvania	30099 Series
Various	UL Listed 120VAC, no greater than 60 watts

ADDITIONAL CONNECTIONS

FREEZER



OPTIONAL



NOTE: Door Heater, Thermal Switch and Heated Relief Port included on Freezers only.
Door Heater and Thermal Switch optional on Coolers

NOTE: If Auxiliary Lights are not powered from the Door Circuit, the Red Aux Wire from the Door Circuit must be capped off or removed by Qualified Electrician

Arctic
WALK-IN COOLERS AND FREEZERS
Engineering Reimagined®

FLORIDA, USA (305) 883-5581
CALIFORNIA, USA (626) 508-0920





ELECTRICIAN MUST PROVIDE SEAL-OFFS ON THE WARM SIDE OF ALL INCOMING CONDUIT LINES TO PREVENT CONDENSATION FROM FORMING INSIDE THE CONDUIT.
(SEE DETAILS PAGE)

SINGLE POLE WIRING DIAGRAM FOR SWICTH 1908-603 W/ DIAL THERM

NOTE: DOOR MUST BE DISCONNECTED FROM ELECTRICAL SUPPLY FOR INSTALLATION AND ADJUSTMENTS.
NOTE: CONDUIT PENETRATIONS MUST BE SEALED INTERNALLY AND EXTERNALLY WHERE THEY ENTER THE WALK-IN BOX.

Update: 11/16/22

Field Connection
120V / 60V / 1PH
15 Amp Circuit Required

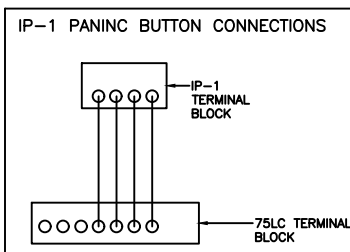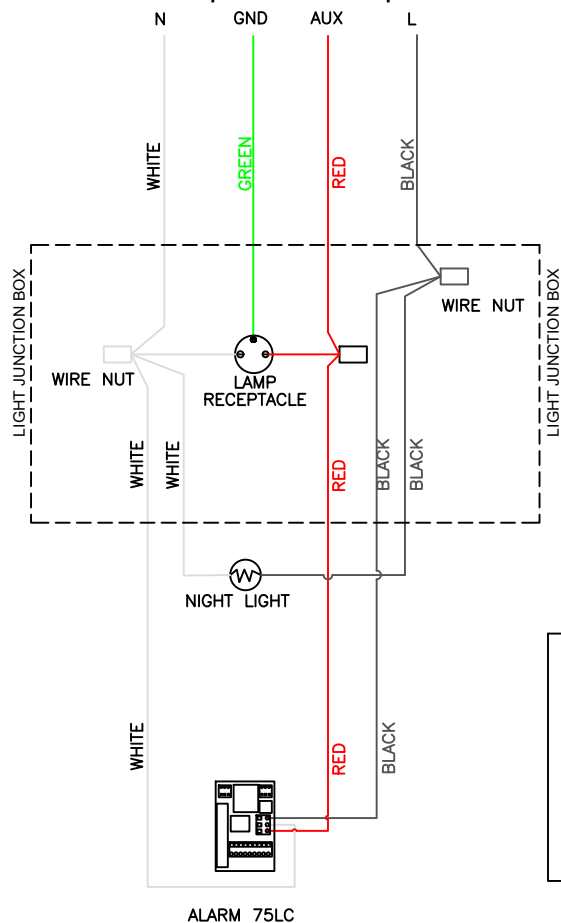





ELECTRICIAN MUST PROVIDE SEAL-OFFS ON THE WARM SIDE OF ALL INCOMING CONDUIT LINES TO PREVENT CONDENSATION FROM FORMING INSIDE THE CONDUIT. (SEE DETAILS PAGE)

Arctic®
WALK-IN COOLERS AND FREEZERS
Engineering Reimagined®

FLORIDA, USA (305) 883-5581
CALIFORNIA, USA (626) 508-0920

This is a 120VAC, 15 amp circuit auxiliary lights max combined draw 10 amps	
Manufacturer	Model
Keil (Component Hardware)	LED48X754
Kason	1802, 1802NL, 1803, 1804, 1806, 1807, 1808, 1808NM, 1808FM, 1809, 1810EZ Series, 1810LX, 1810LC, 1820
MaxLite	LSV Series, JJ Series
Osram Sylvania	30099 Series
Various	UL Listed 120VAC, no greater than 60 watts

ADDITIONAL CONNECTIONS
FREEZER **OPTIONAL**



NOTE: Door Heater, Thermal Switch and Heated Relief Port included on Freezers only.
Door Heater and Thermal Switch optional on Coolers

NOTE: If Auxiliary Lights are not powered from the Door Circuit, the Red Aux Wire from the Door Circuit must be capped off or removed by Qualified Electrician

SINGLE POLE WIRING DIAGRAM FOR A/V ALARM 75LC AND PANIC BUTTON

NOTE: DOOR MUST BE DISCONNECTED FROM ELECTRICAL SUPPLY FOR INSTALLATION AND ADJUSTMENTS.
NOTE: CONDUIT PENETRATIONS MUST BE SEALED INTERNALLY AND EXTERNALLY WHERE THEY ENTER THE WALK-IN BOX.

Update: 11/16/22